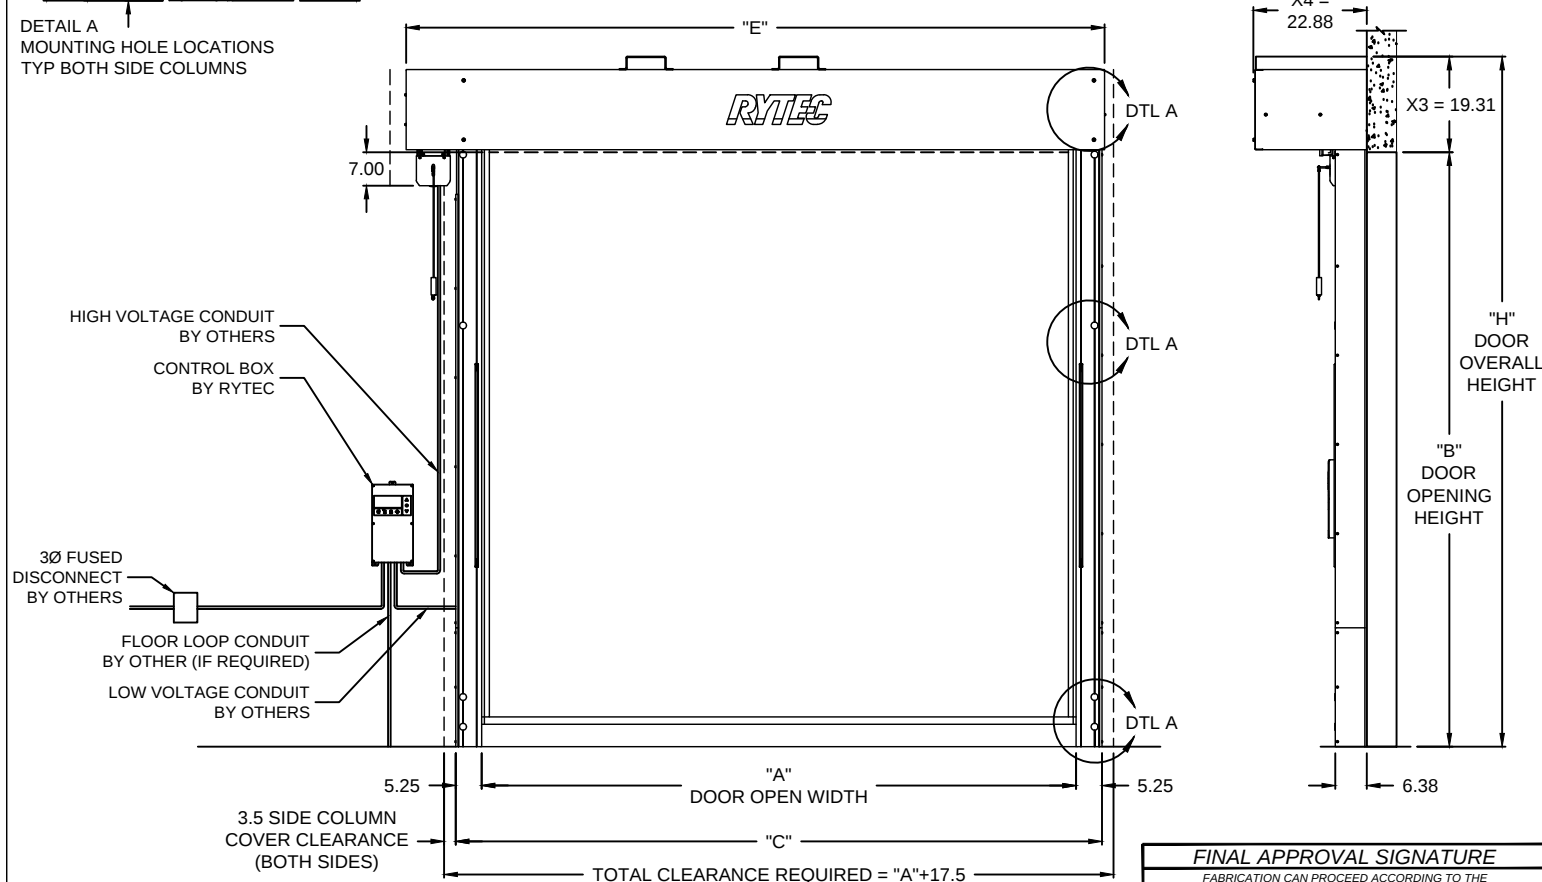



$$\begin{aligned} C &= A + 10.50 \\ E &= A + X_1 + X_2 \\ H &= B + X_3 \end{aligned}$$

DRAWING NOT TO SCALE, ALL DIMENSIONS IN INCHES

DOOR NO.	A	B	C	E	H

PANEL OPTIONS

WINDOWS-20x20 (\$) ☐ ONE (1) ☐ TWO (2) (A>78) ☐ THREE (3) (A>114)	BOTTOM SEAL ☒ BLACK (STD) ☐ YELLOW
--	--

ELECTRICAL OPTIONS

☐ 460v - 3ph ☐ 230v/208v - 3ph ☐ 230v - 1ph ☐ 480v OPEN DELTA, UNGROUNDED (\$)	☐ 575v - 3ph (\$) (INCLUDES NEMA 4 METAL ENCLOSURE WITH 575/460 TRANSFORMER)
--	---

STANDARD FEATURES

1. SYSTEM 4+ DRIVE AND CONTROL
2. AUTOMATIC SELF REPAIRING.
3. LIGHT CURTAIN IN DOOR LINE.
4. (2) SETS PATHWATCH SAFETY SYSTEM.

UPGRADE OPTIONS

☐ SLANT HOOD (\$) ☐ FLAT HOOD (\$)
☐ MOTOR COVER (\$)
☐ EXTERIOR OPENING/PRESSURE PACKAGE (\$)
☐ RIGHT HAND DRIVE (LH STD.)
☐ ROTARY DISCONNECT (NON-FUSED) (\$)
☐ BT44 (BLUETOOTH ACCESS TERMINAL) (\$)
 NIGHT SWITCH FUNCTION: _____
☐ SELECTOR SWITCH ON CONTROL BOX (\$)
 FUNCTION: _____
☐ PATHWATCH II LIGHT SET (\$) (2) LIGHTS, CABLES AND BRACKETS
☐ PHOTOEYES IN LIEU OF LIGHT CURTAINS

ACTIVATION OPTIONS (\$)

☐ — PUSHBUTTON	☐ RADIO CONTROL RCVR
☐ — PULL CORDS	(INCLUDE MIN 2 XMIT)
☐ — MOTION DETECTOR	— 1 BTN TRANSMITTER
☐ — MOTION/PRESENCE	— 2 BTN TRANSMITTER
☐ DUAL LOOP CONTROLLER	— 4 BTN TRANSMITTER

OPTION NOTES

(\$) = PRICING CHANGE IF NOT INCLUDED IN QUOTE

PLEASE SPECIFY VOLTAGE

RYTEC CORPORATION

ONE CEDAR PARKWAY, JACKSON, WI 53037-0403

APPROVAL DRAWING

FLEXTECÒ - SYSTEM 4+

FOR DOOR SIZES UP TO 12'-0" WIDE X 12'-0" HIGH

CUSTOMER:

LOCATION:

DATE: _____

REV.: A

DRAWING NO.: 2301-01T

FINAL APPROVAL SIGNATURE

FABRICATION CAN PROCEED ACCORDING TO THE SPECIFICATION SHOWN EXCEPT AS NOTED

APPROVED BY:

PRINT NAME: _____

SIGNATURE: _____

DATE: