


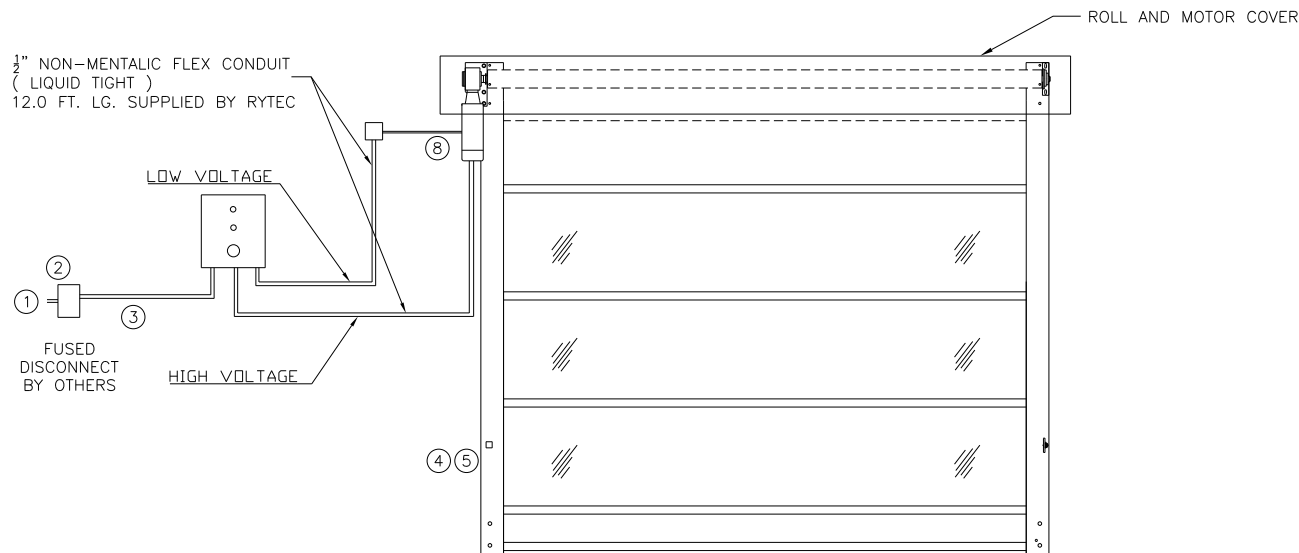

GENERAL ELECTRICAL INSTALLATION NOTES

- ALL CONDUIT CONNECTIONS TO THE OPERATOR SHOULD ENTER THROUGH THE BOTTOM OF THE CONTROL BOX. ANY CONDUIT ENTRIES IN THE SIDES OR TOP OF THE CONTROL BOX WILL VOID THE WARRANTY.
- ALL FIELD ELECTRICAL WORK MUST CONFORM TO ANY APPLICABLE LOCAL OR NATIONAL ELECTRIC CODES.
- ALL FIELD WIRING TO BE MINIMUM 60° C, 600V RATED COPPER STRANDED TYPE.
- INSTALL ALL LOW VOLTAGE (< 50V) WIRING IN CONDUIT SEPARATE FROM HIGH VOLTAGE WIRING. FAILURE TO SEPARATE HIGH AND LOW VOLTAGE WILL VOID WARRANTY.
- TAKE NECESSARY PRECAUTIONS TO PREVENT MOISTURE FROM ENTERING THE OPERATOR THROUGH CONDUIT.
- THIS DOCUMENT OUTLINES THE GENERAL ELECTRICAL REQUIREMENTS FOR THIS DOOR TYPE. REFER TO ELECTRICAL SCHEMATIC PROVIDED WITH THE DOOR FOR COMPLETE REQUIREMENTS.

SERVICE, DISCONNECT AND FUSING RECOMMENDATIONS

208-230V/3PH/60HZ

MINIMUM SERVICE: 15 AMP
DISCONNECT: 30 AMP, 300V MIN., 3 POLE
FUSES: 15 AMP, CLASS R OR EQUAL

460V/3PH/60HZ

MINIMUM SERVICE: 15 AMP
DISCONNECT: 30 AMP, 600V MIN., 3 POLE.
FUSES: 15 AMP, CLASS R OR EQUAL

575V/3PH/60HZ

MINIMUM SERVICE: 15 AMP
DISCONNECT: 30 AMP, 600V MIN., 3 POLE.
FUSES: 15 AMP, CLASS R OR EQUAL

Requirements: Responsible Party*

- BRANCH CIRCUIT PROTECTION AND MAIN POWER DISTRIBUTION WIRES: 1 _____
- SUPPLY & MOUNTING OF FUSED DISCONNECT (INCLUDING FUSES) WITHIN 3 FT OF THE DOOR OPENING: 2 _____
- WIRING FROM DISCONNECT TO DOOR OPERATOR: 3 _____
- MOUNTING OF REMOTE PHOTO EYES AND ACTIVATORS, (NOT SHOWN): 4 _____
- CONDUIT, WIRE AND OTHER MATERIAL REQUIRED FOR CONNECTION OF PHOTO EYES TO CONTROL PANEL. 5 _____
- WIRING OF ACTIVATORS (SEE ACTIVATOR MANUALS): 6 _____
- TERMINATION OF ALL WIRING: 7 _____

*Resp. Party to provide all materials and labor to complete the work indicated.

Activator Options, Qty, Responsible Party

PHOTO EYE: _____

PULLCORD: _____

MOTION DETECTOR: _____

PUSH-BUTTON: _____

FLOOR LOOP: _____

OTHERS (SEE NOTES): _____

Additional Notes:

RYTEC CORPORATION

ONE CEDAR PARKWAY, JACKSON, WI 53037-0403

Model MT

Electrical Scope Of Work

CUSTOMER:

LOCATION:

DATE: 01/06/12 DEALER: APPV'D BY:

DRAWING NO.: 41165RL-00T REV.: —