


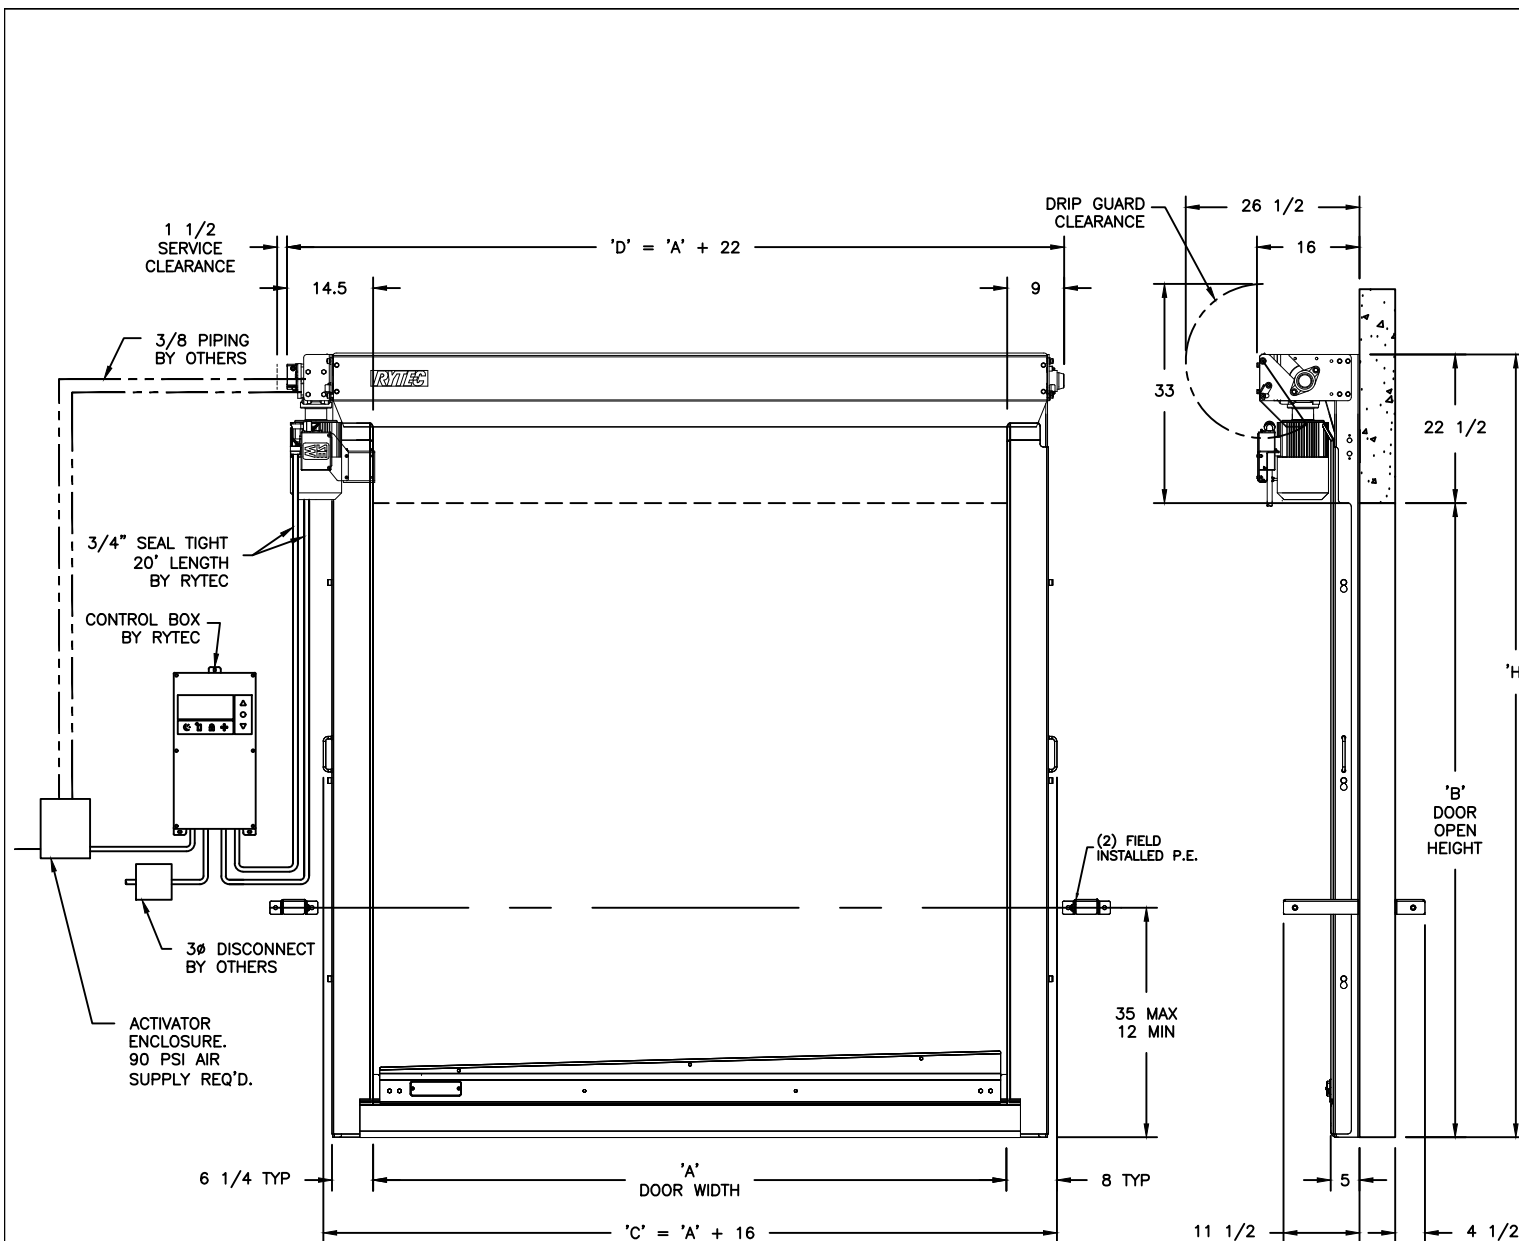

DRAWING NOT TO SCALE, ALL DIMENSIONS IN INCHES					
DOOR NO.	A	B	C	D	H
-	-	-	-	-	-
MODEL					
MODEL: CR - 5700			PANEL COLOR		
PANEL MATERIAL			☐ WHITE ☐ BLUE		
☒ 2-PLY USDA					
ELECTRICAL OPTIONS					
☐ 460v - 3ph ☐ 230v/208v - 3ph ☐ 230v - 1ph ☐ 480v OPEN DELTA, UNGROUNDED (\$)			☐ 575v - 3ph (\$) (INCLUDES NEMA 4 METAL ENCLOSURE WITH 575/460 TRANSFORMER)		
STANDARD FEATURES					
1. (2) SET FIELD INSTALLED PHOTOEYES 2. SYSTEM 4+ DRIVE AND CONTROL 3. NEMA 4X CONTROL BOX 4. WIRELESS BOTTOM BAR					
UPGRADE OPTIONS					
☐ SINGLE WINDRIB (\$)					
☐ DOUBLE WINDRIB (\$)					
☐ RIGHT HAND DRIVE (LH STD.)					
☐ VISION PANEL					
☐ 575/460V STEP DOWN TRANSFORMER (\$) INCLUDED IN RYTEC CONTROL BOX					
☐ BTA4 (BLUETOOTH ACCESS TERMINAL) (\$)					
NIGHT SWITCH FUNCTION: _____					
☐ SELECTOR SWITCH ON CONTROL BOX (\$)					
FUNCTION: _____					
☒ OTHERS (DESCRIBE IN NOTES)					
ACTIVATION OPTIONS (\$)					
☐ PHOTOEYE					
☐ PULL CORDS					
☐ MOTION DETECTOR					
☐ RADIO CONTROL					
☐ PUSHBUTTON					
☐ FLOOR LOOP					
☐ OTHERS (DESCRIBE IN NOTES)					
OPTION NOTES					
NOTES: 1) THE DOOR IS COMPLIANT WITH UL SPECIFICATIONS FOR SANITATION. HOWEVER, THE PNEUMATIC DRIP TRAY SYSTEM IS NOT UL SANITATION COMPLIANT. 2) PNEUMATIC REAR DRIP TRAY. 90 PSI AIR SUPPLY & 3/8 PIPING BY OTHERS. (\$) = PRICING CHANGE IF NOT INCLUDED IN QUOTE					
ANY OPTIONS BEYOND STANDARD WILL INVALIDATE UL SANITARY COMPLIANCE. REFER TO APPROVAL DRAWING 7C196TEMP FOR NON-UL COMPLIANT DOORS (CR5700)					
RYTEC CORPORATION					
ONE CEDAR PARKWAY, JACKSON, WI 53037-0403					
APPROVAL DRAWING					
CLEAN-ROLL - SYSTEM 4+					
CUSTOMER:					
LOCATION:					
DATE:					REV.: _____
DRAWING NO.: 801-07T					

FINAL APPROVAL SIGNATURE	
FABRICATION CAN PROCEED ACCORDING TO THE SPECIFICATION SHOWN EXCEPT AS NOTED	
APPROVED BY: _____	
PRINT NAME: _____	
SIGNATURE: _____	
DATE: _____	